



NOTES

N.T.S.

1. PHYSICAL SEPARATION MUST BE MAINTAINED AT ALL CONNECTION POINTS OF NEW OR REHABILITATED WATERMAINS TO THE EXISTING SYSTEMS UNTIL BACTERIOLOGICAL TESTS HAVE PASSED.
2. CONNECTION OF THE WATERMAIN TO BE COMPLETED AS PER PUC CONSTRUCTION SPECIFICATIONS SECTION 2.3.19. ONLY AFTER RECEIPT OF AUTHORIZATION BY THE PUC ENGINEER.
3. CONTRACTOR IS RESPONSIBLE FOR DESIGN, INSTALLATION AND MAINTENANCE OF THRUST BLOCKS THROUGHOUT CONSTRUCTION.
4. DEPRESSURIZATION POINT TO REMAIN OPEN WHENEVER STAFF ARE IN ACCESS PIT.
5. BACKFLOW TO BE SELECTED AND FIELD TESTED IN ACCORDANCE WITH CSA STANDARDS B64.10 AND B64.10.1

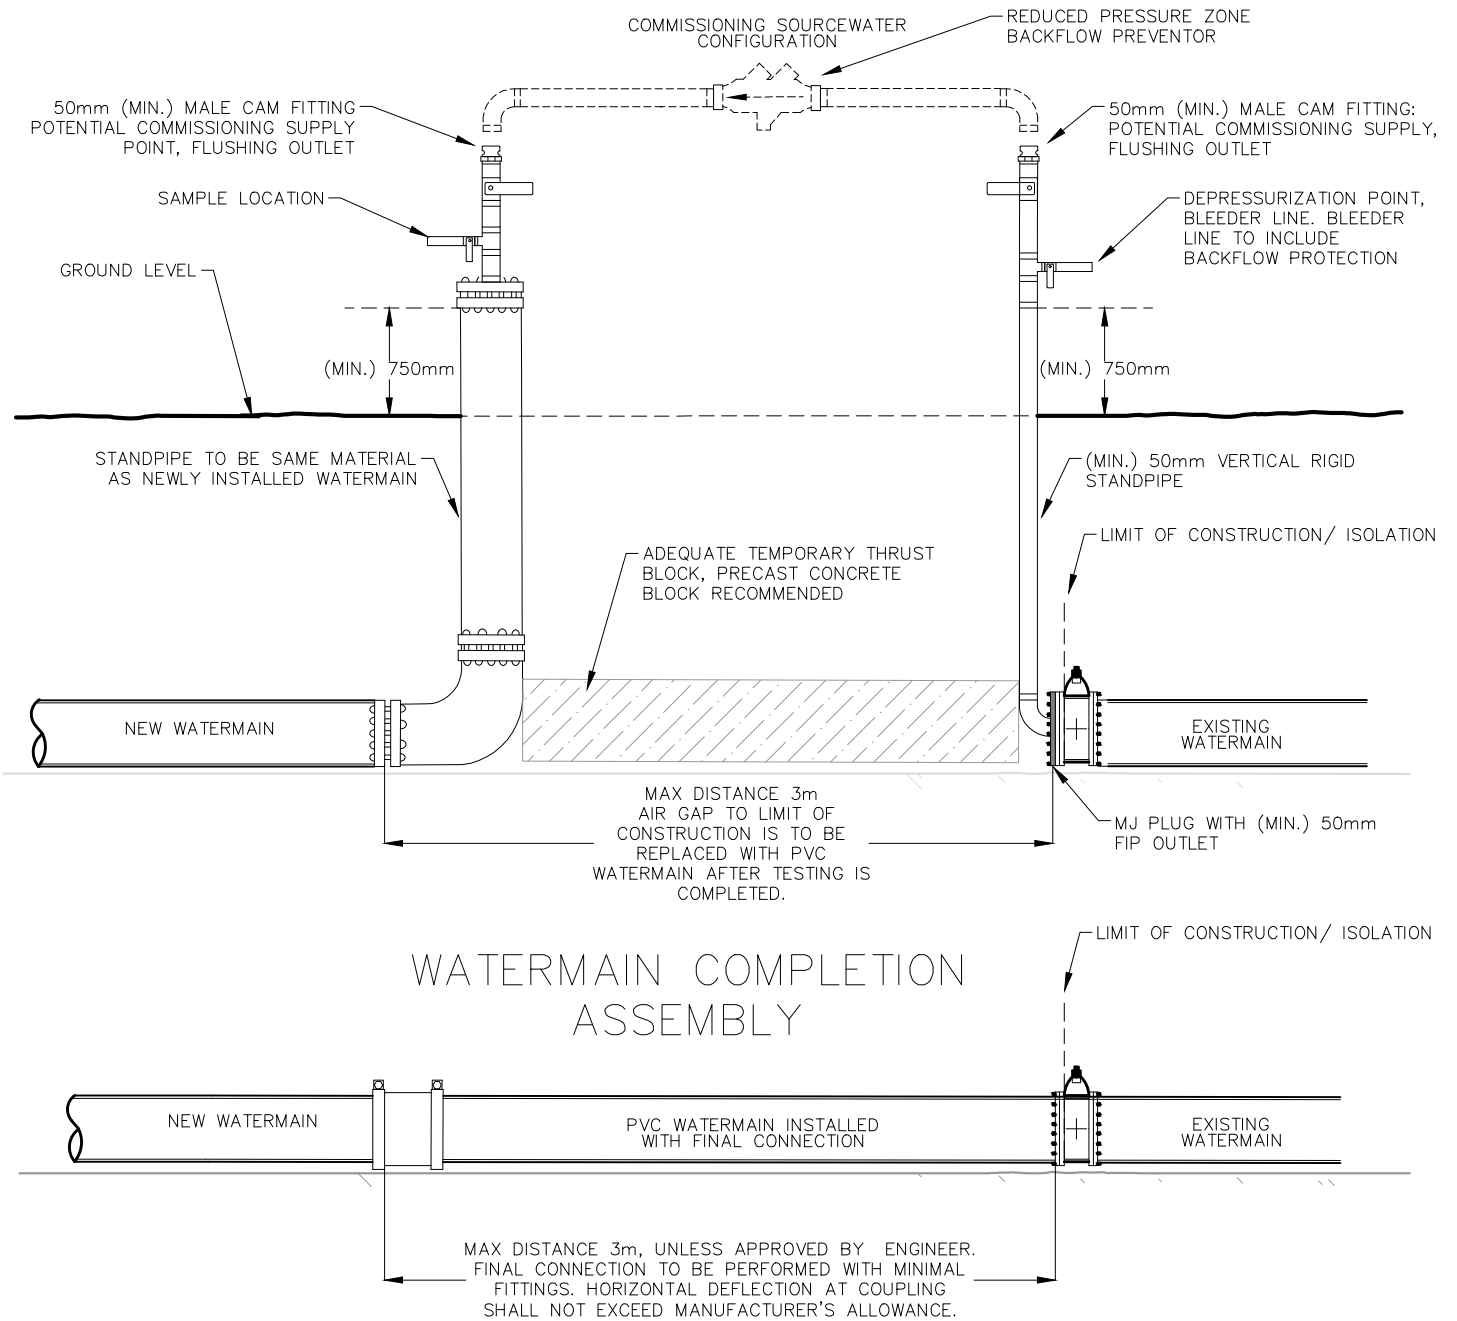

PETERBOROUGH UTILITIES COMMISSION  
STANDARD WATERWORKS DRAWING

	TITLE	No.	REVISION	DATE
	PHYSICAL SEPARATION REQUIRED FOR NEW CONSTRUCTION	1.		
		2.		
DRAWN BY: J. ELLISON DESIGNED: J. ELLISON	APPROVED: K. CONLIN DATE: 01-11-2023	<h1>A3121</h1>		